C1000LP Configuration scheme - june 2016

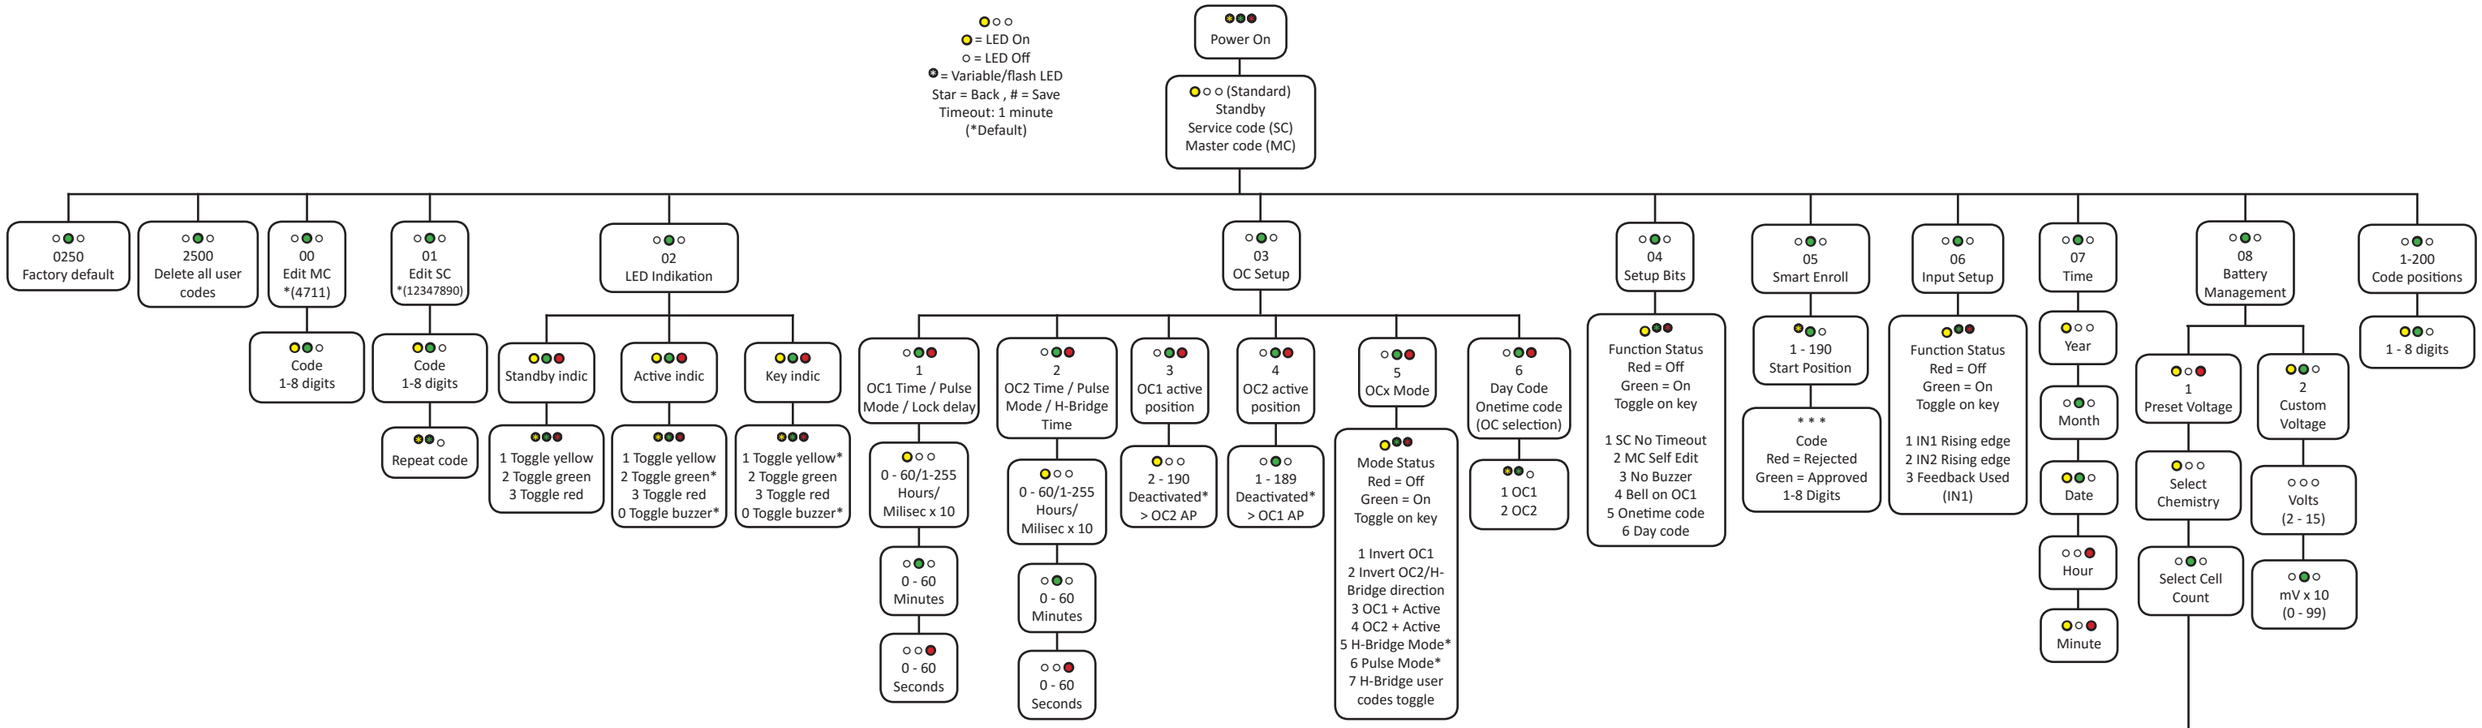

Value	Chemistry	Low power	Cells
0	Disable		-
1	Alkaline (1,5V)	0,95V	3 - 10
2	Lithium (3V)	2,3V	1 - 5
3	Lipo, Li-ion (3,7V)	3,37V	1 - 4
4	Lead Acid (2,1V)	1,95V	2 - 7

CONLAN
secure open